

IEC 61557-8
EN 61557-8

ISO-Check

Model	120 V	230 V
Frecuencia/Frequency	50/60 Hz	
	6 A gL	
Range °C	-25 °C ... +55 °C	
IP code	20	


BORNES DE CONEXIÓN/WIRING CONNECTION

min. <input type="checkbox"/> L,N,PE	0,5 mm ²	
max. <input type="checkbox"/> L,N,PE	2,5 mm ²	4 mm ²

ES Indicaciones de seguridad


La conexión y el montaje del ISO-Check sólo deben realizarse por un electricista especializado. Deben observarse las normativas y disposiciones de seguridad, así como las prescripciones y las leyes específicas del país. Antes de iniciar el montaje debe comprobarse que el aparato no presente daños externos. En caso de observar daños u otros defectos, no debe efectuarse el montaje. Un fusible o interruptor automático es necesario para proteger al equipo ISO-Check. El empleo del ISO-Check está limitado a las condiciones indicadas y mostradas en estas instrucciones de montaje. Si se exceden los valores indicados, el protector puede ser dañado, así como las cargas conectadas a él. La manipulación inadecuada o la modificación del aparato invalidan el derecho de garantía.

Indicaciones del equipo/Indications device

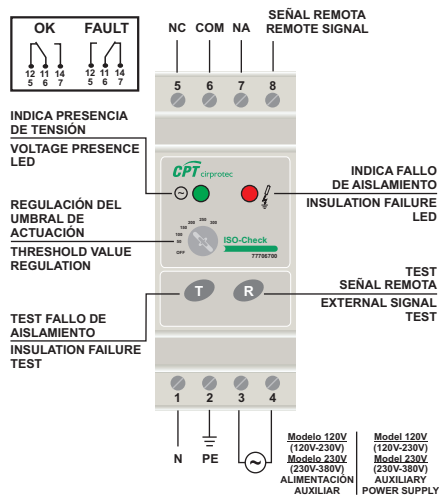

Conexión/Connection

Topología Red Eléctrica (IT)/Electrical Network Topology (IT)

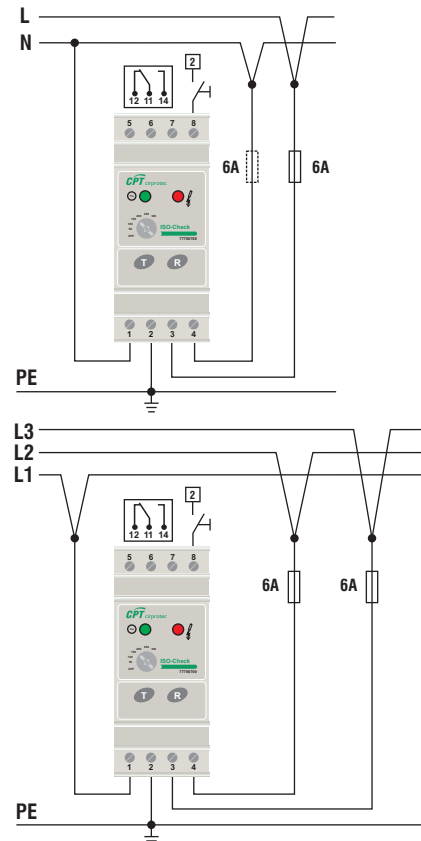

EN Safety instructions

Wiring and assembly of the ISO-Check must only be carried out by professionally qualified electricians. National and local electrical standards, rules and regulations must be taken into consideration for the correct installation of the equipment. CPT cannot be held responsible for a poor installation, design or any subsequent damage. Before proceeding with the installation, check the external status of the unit ensuring it has not suffered any damage during transportation or other. A fuse or a circuit breaker is needed to protect the ISO-Check. The system shall under no circumstance be installed if there is any evidence of damage or flaws. The use of ISO-Check is limited to the scope and conditions described in the pages of this installation guide. If the indicated values are exceeded, this may result in damage to the protector and the devices it is protecting. Inappropriate manipulation or modifications of any kind, will invalidate the guarantee under which this electrical apparatus is delivered.

La conexión a una toma de tierra ES INDISPENSABLE para el óptimo funcionamiento del vigilante de aislamiento.
Un fusible o interruptor aut. es necesario para proteger al equipo.
El vigilante de aislamiento NO DEBE instalarse nunca a la intemperie.
Connection to an earthing system IS ESSENTIAL for a proper operation of the insulation monitoring device.
A fuse or a circuit breaker is needed to protect the tester
The insulation monitoring device SHOULD NOT ever installed outdoor.

Cirprotec se reserva el derecho a realizar cualquier modificación del producto sin previo aviso. Cirprotec reserves the right to introduce any type of changes of the product without notice.